

- FIRE STANDARDS TO BE ACHIEVED**
- Doors and partitions required to be fire resisting are to be in accordance with BS476, as amended.
 - Fire resisting doors required to resist the passage of smoke at ambient temperature conditions should, unless tested in accordance with BS476, section 31.1, 1983, be fitted with a smoke seal, intumescent strips and positive self closing device.
 - Fire alarm to comply with BS5839, part 1 2002. Installing engineer to consult with Fire Authority.
 - Emergency lighting installation is to comply with BS5266, Part 1 2005.
 - Installing engineer to refer to paragraph 3.1 of BS5266 part 1 in particular reference to consultation with Fire Authority.
 - Fire safety related signs and notices to conform to BS5499, part 1, (incorporating running man symbol on fire exits) and other pictograms as required.
 - Maintained illuminated "Fire Exit" signs required over all fire exits and to indicate escape routes are to conform to BS2560.
 - Fire fighting equipment to comply with BS EN3.
 - Upholstered seating furniture to satisfy as minimum standard ignition source 0 and Crib ignition source 5 as specified in BS5852, 2006, clause 11, methods of test assessment of the ignitibility of upholstered seating by smouldering and flaming ignition sources.
 - Curtains and other textile hangings must be inherently flame retardant or be treated with a durable flame retardant. They must be capable of complying with the Type B performance requirements of BS5867, part 2, 1980 - specification for fabrics for curtains and drapes-flammability requirements.
 - Textile floor coverings should be tested to BS4790 (effects of small ignition source hot metal nut method). Vertically hung textiles should conform to BS5438.
 - Artificial foliage, and other decorative effects are to be fire retardant to the satisfaction of the fire authority.
 - Wall and ceiling linings are to be class 1 surface spread of flame (as described in BS476, Part 7) in public areas. Class 0, in escape routes.
 - Test certificates should be provided in respect of Fire alarm, Emergency lighting, maintained exit signs, furniture and curtains etc.
 - Fire Exit doors All fire exit doors shall discharge to a place of safety



FIRE LEGEND

- Maintained exit signs
- FD30S Fire Door, 30 minutes resistance with cold smoke seals and door closer.
- FD60S Fire Door, 60 minutes resistance with cold smoke seals and door closer.
- FIRE NOTICE SIGN
- N1 "FIRE EXIT - KEEP CLEAR" notice
- N2 "FIRE DOOR KEEP SHUT" notice
- N3 "FIRE DOOR LOCKED KEEP SHUT" notice
- N4 "PUSH BAR TO OPEN" notice

- ☠ Audible warning device.
- ☠ Audible warning device with flashing beacon.
- ⓔ 230v Maintained Emergency Luminaire
- ⓗ Heat detector.
- Ⓢ Smoke detector.
- ⓕ Fire alarm panel.
- ☐ Break glass call point.
- △ AFFF 6 ltr AFFF foam extinguisher fixed to wall with handle 1.1m above FFL.
- △ CO2 2kg 2kg CO2 extinguisher fixed to wall with handle 1.1m above FFL.
- ☠ Smoke detection to be installed within ceiling void where void exceeds 800mm deep.

LICENCING LEGEND

- Extent of Licenced Premises
- Those parts of the premises to be used for licensable activities
- /// See landlords / other tenants details for fire precautions outside of the line of demise

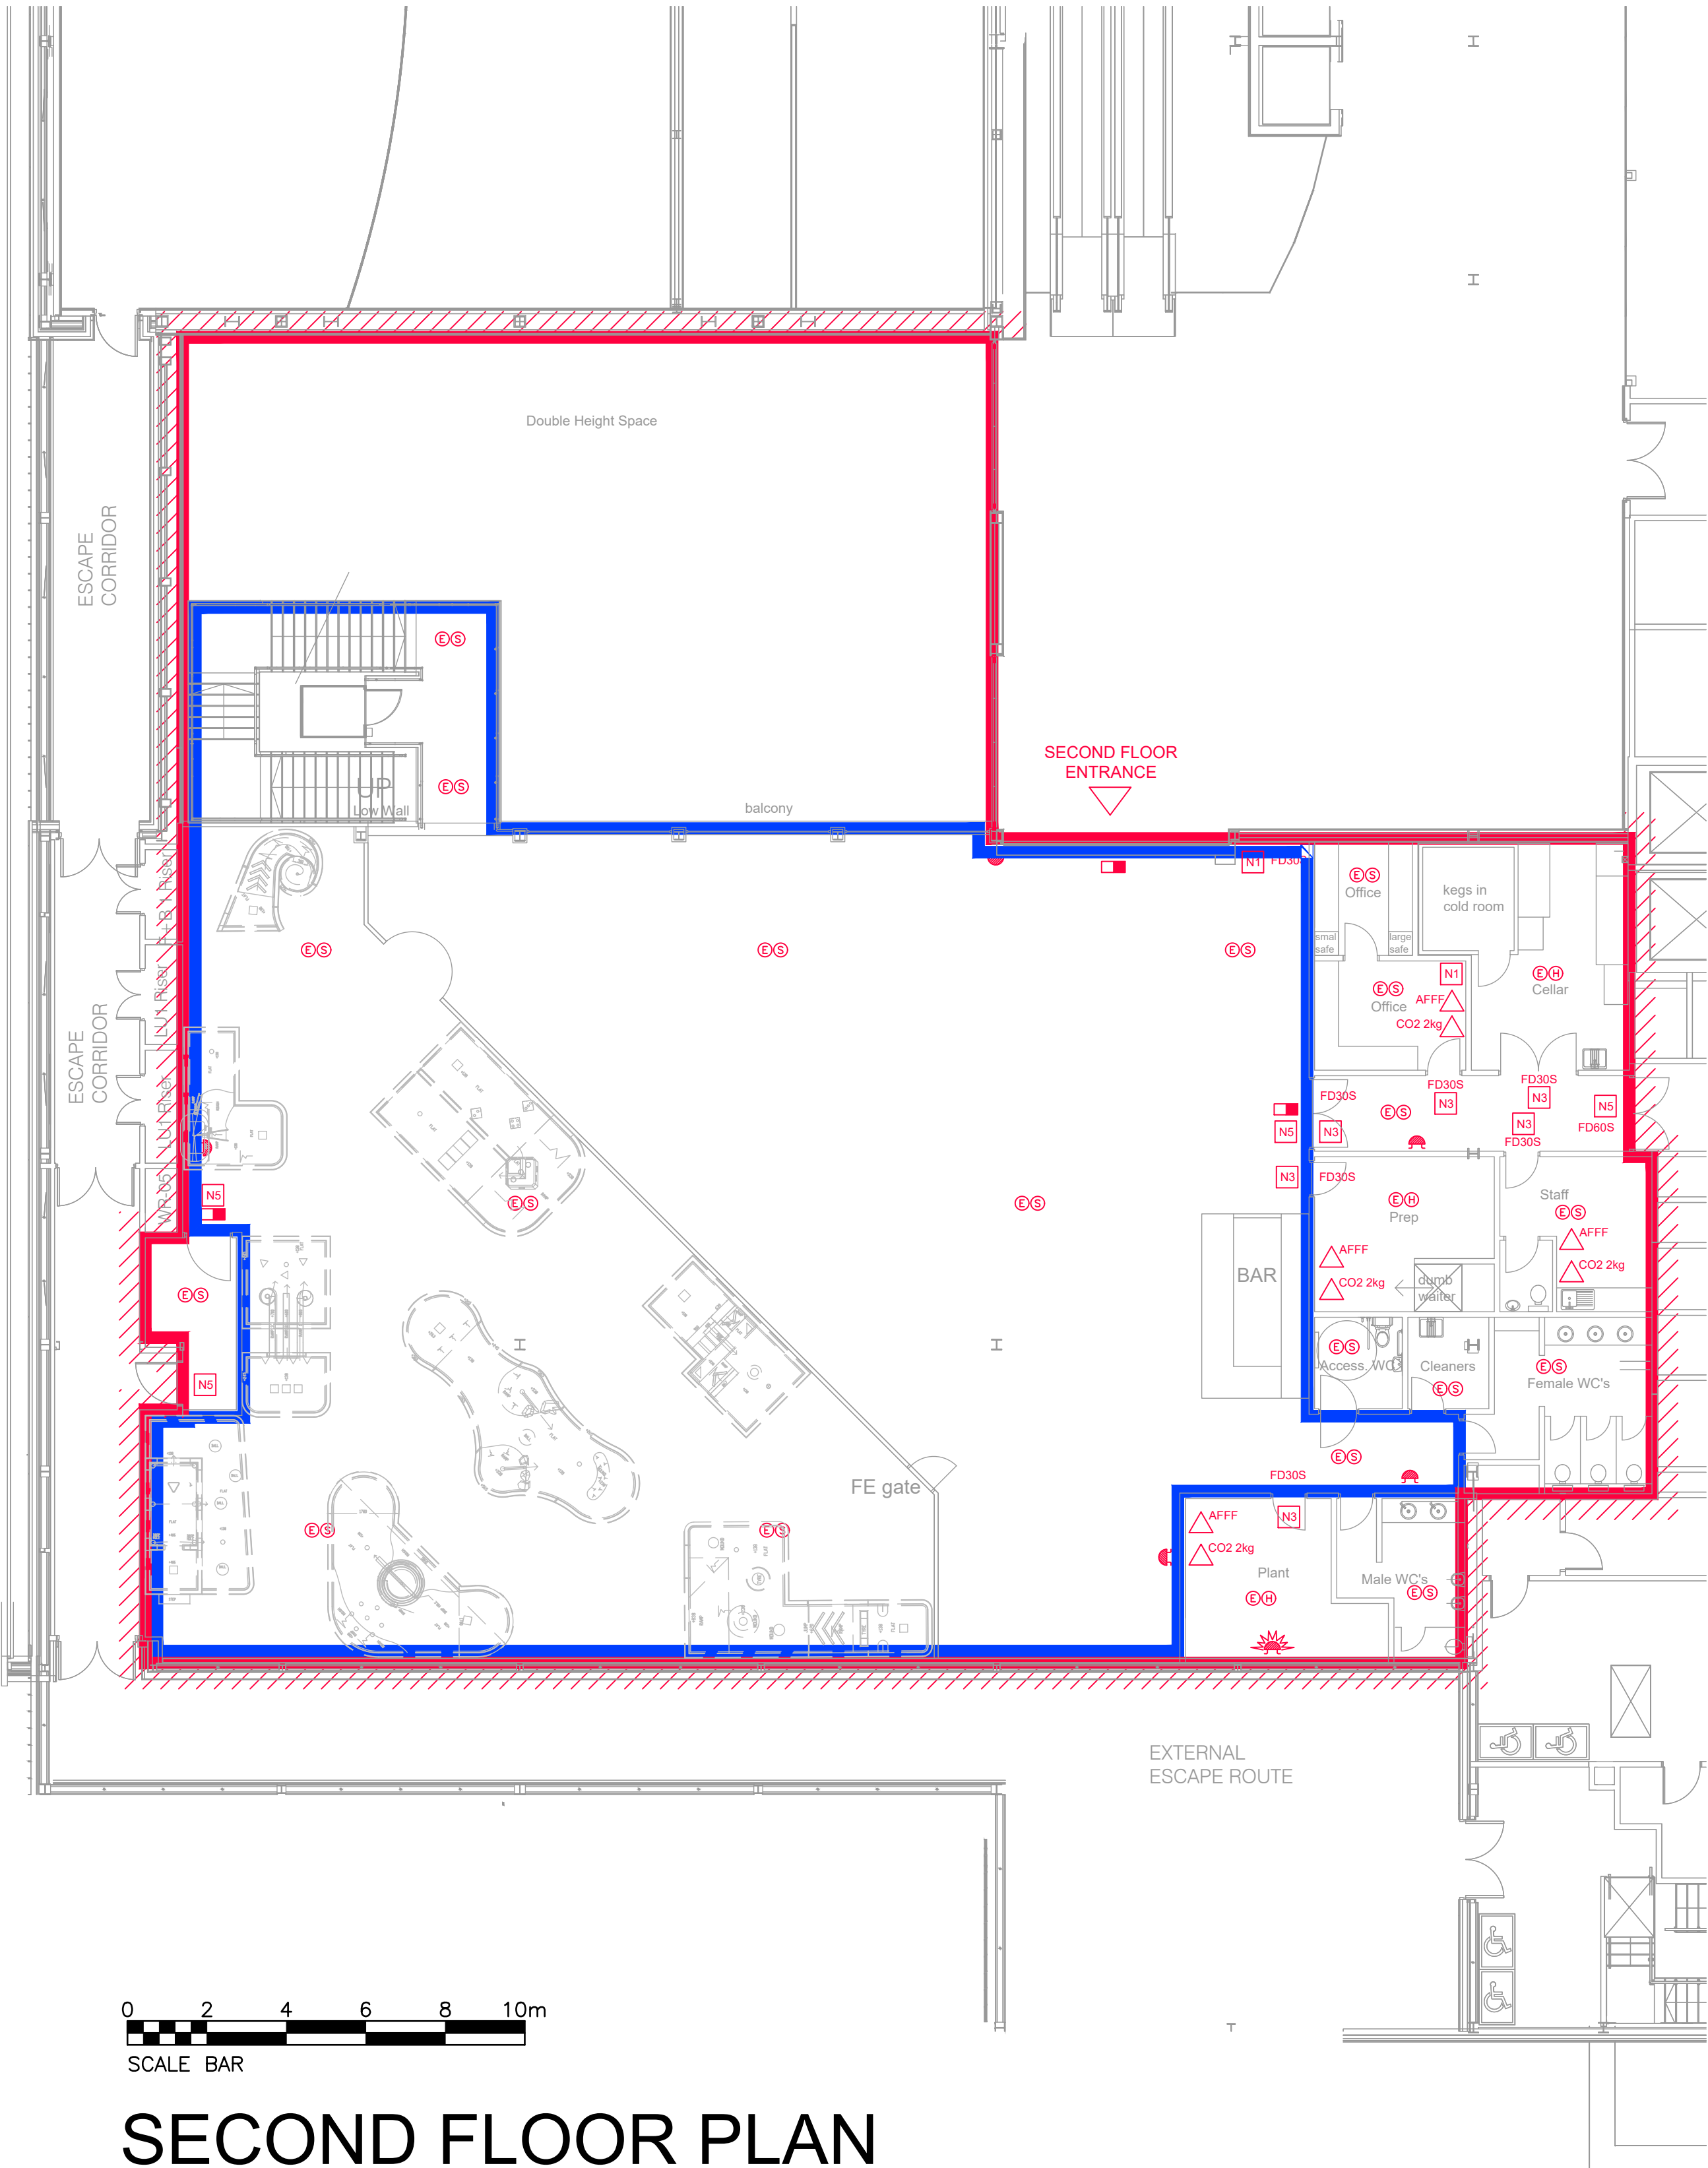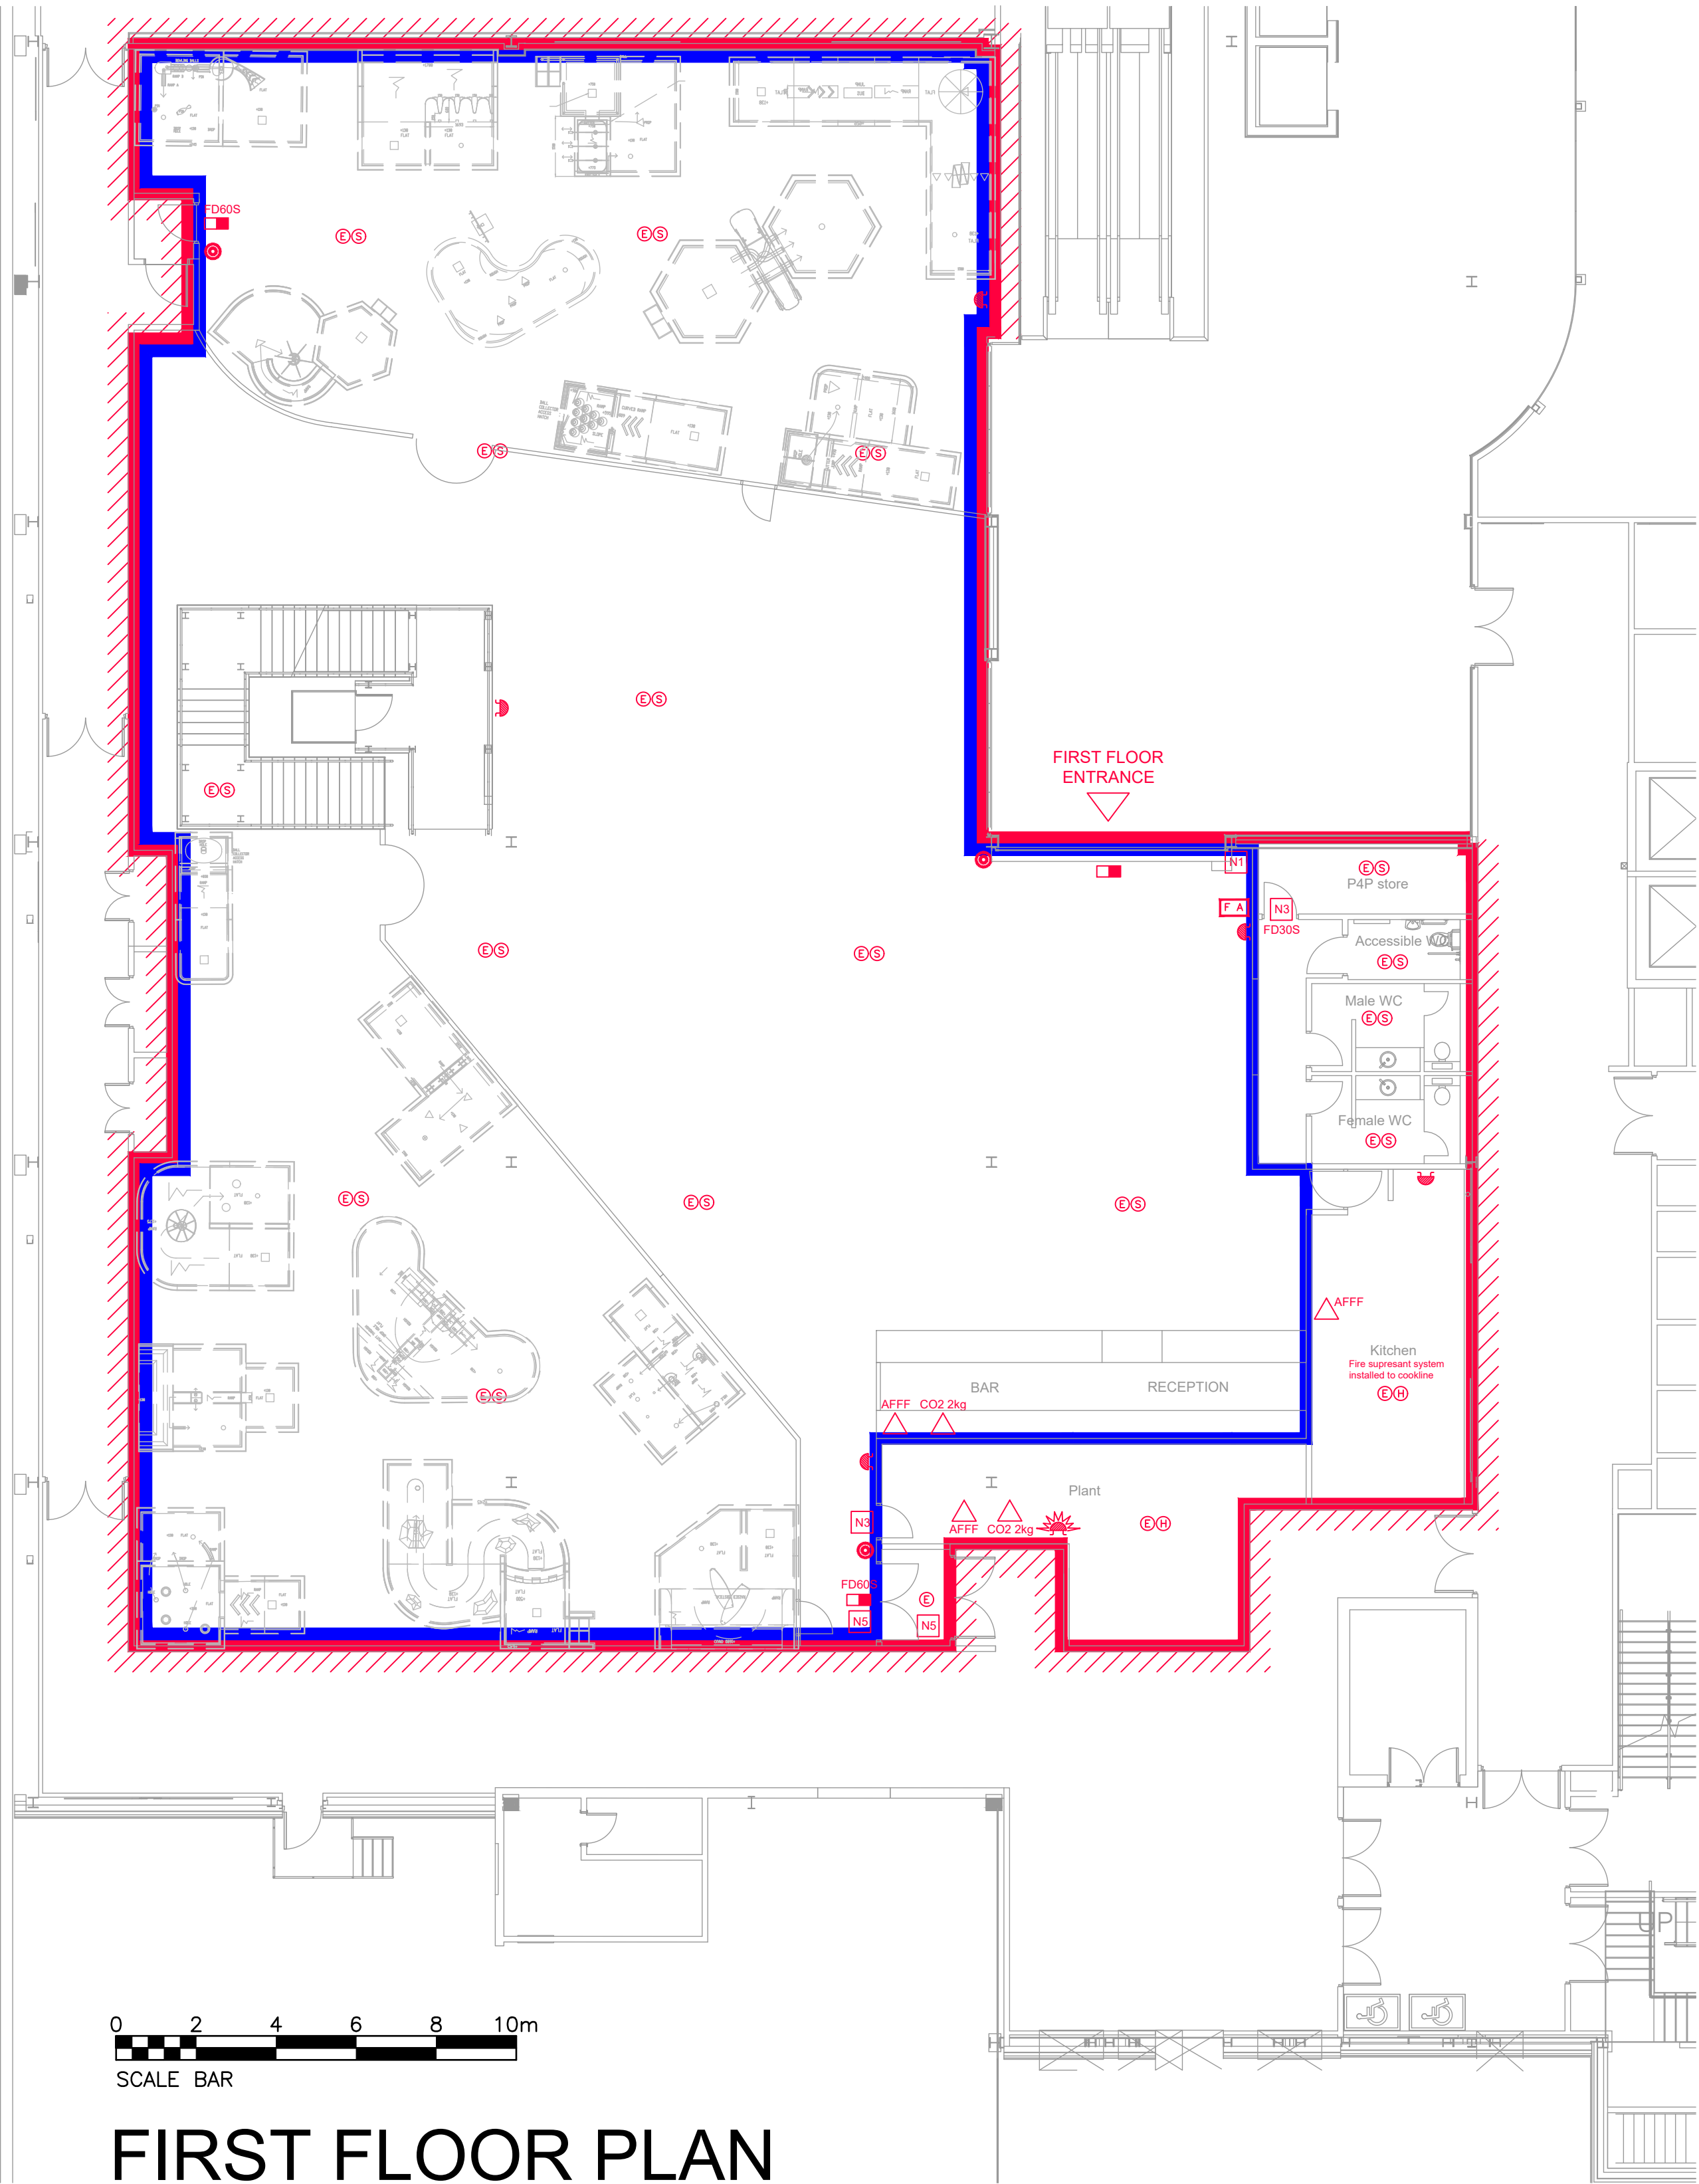

NOTES

THE CONTRACTOR IS RESPONSIBLE FOR CHECKING ALL DIMENSIONS AND NOTIFYING ALL DISCREPANCIES TO THE DESIGNER.

USE FIGURED DIMENSIONS IN PREFERENCE TO SCALED DIMENSIONS.

ALL WORK TO BE IN ACCORDANCE WITH CURRENT BUILDING REGULATIONS.

COPYRIGHT OF THIS DRAWING IS RESERVED BY G.I.A. LIMITED, AND IS ISSUED ON THE CONDITION THAT IT IS NOT COPIED, REPRODUCED OR DISCLOSED TO ANY THIRD PARTY EITHER WHOLLY OR IN PART WITHOUT THE CONSENT IN WRITING OF G.I.A. LIMITED.

REV	PLAN UPDATED	22.09.22
DESCRIPTION		DATE
AMENDMENTS		
CLIENT	THE ORIGINAL BOWLING COMPANY	
JOB	PROPOSED PUTTSTARS QUEENSGATE SHOPPING CENTRE, PETERBOROUGH	
DRAWING	LICENSING PLAN	
JOB NO.	2943	DRAWING NO. 301 A
SCALE	1:125 @ A1	
DRAWN BY	D.J.W....	DATE Dec' 21